

BROADWATER COUNTY ENVIRONMENTAL HEALTH OFFICE

Courthouse: 515 Broadway Townsend, MT 59644
Sanitarian: Julie Lethert, RS

Phone: (406) 266-9210
Fax: (406) 266-3674

On-Site Wastewater Treatment System Permit

PERMIT # 05-108

ISSUED TO: Jeff and Jeanette McCown - shop

ADDRESS: 275 Vigilante Trail Bozeman, MT 59718

PHONE:(406)579-0750

DESCRIPTION OF PROPERTY: Lot# 1C Hilltop Vista Homestead Tract 1 Subdivision

SECTION: 28

TOWNSHIP: 3 North

RANGE: 1 East

ISSUED BY: Julie Lethert, RS

ISSUE DATE: September 26, 2005

INSTALLER: self

EXPIRATION DATE: September 26, 2006

This permit is issued to the property owner based on information provided in the permit application. If any application information is found to be untrue, this permit shall be null and void. This system shall be installed in accordance with current Department wastewater treatment regulations and any special requirements provided for in this permit.

SYSTEM SPECIFICATIONS:

Primary treatment (septic tank):

1000 gallon septic tank with effluent filter

Secondary treatment (drainfield):

600 square feet (300 lineal feet) of drainfield (based on 3 bedrooms)

~~225 lineal feet of gravel less trenches~~ OK

Special requirements (if applicable):

System shall be installed in department approved location.

NOTIFY THIS DEPARTMENT AT LEAST 2 BUSINESS DAYS PRIOR TO COMPLETION OF SYSTEM INSTALLATION. DO NOT COVER SYSTEM UNTIL APPROVAL IS GRANTED BY HEALTH AUTHORITY.


INSPECTED BY: Julie Lethert, RS DATE: 11/23/2005

COMMENTS: owner called for inspection on 11/22/2005
Installation completed by homeowner - installer's report
not required.

Approval by: Julie A. Lethert

Title: B.C. Sanitarian

INSET

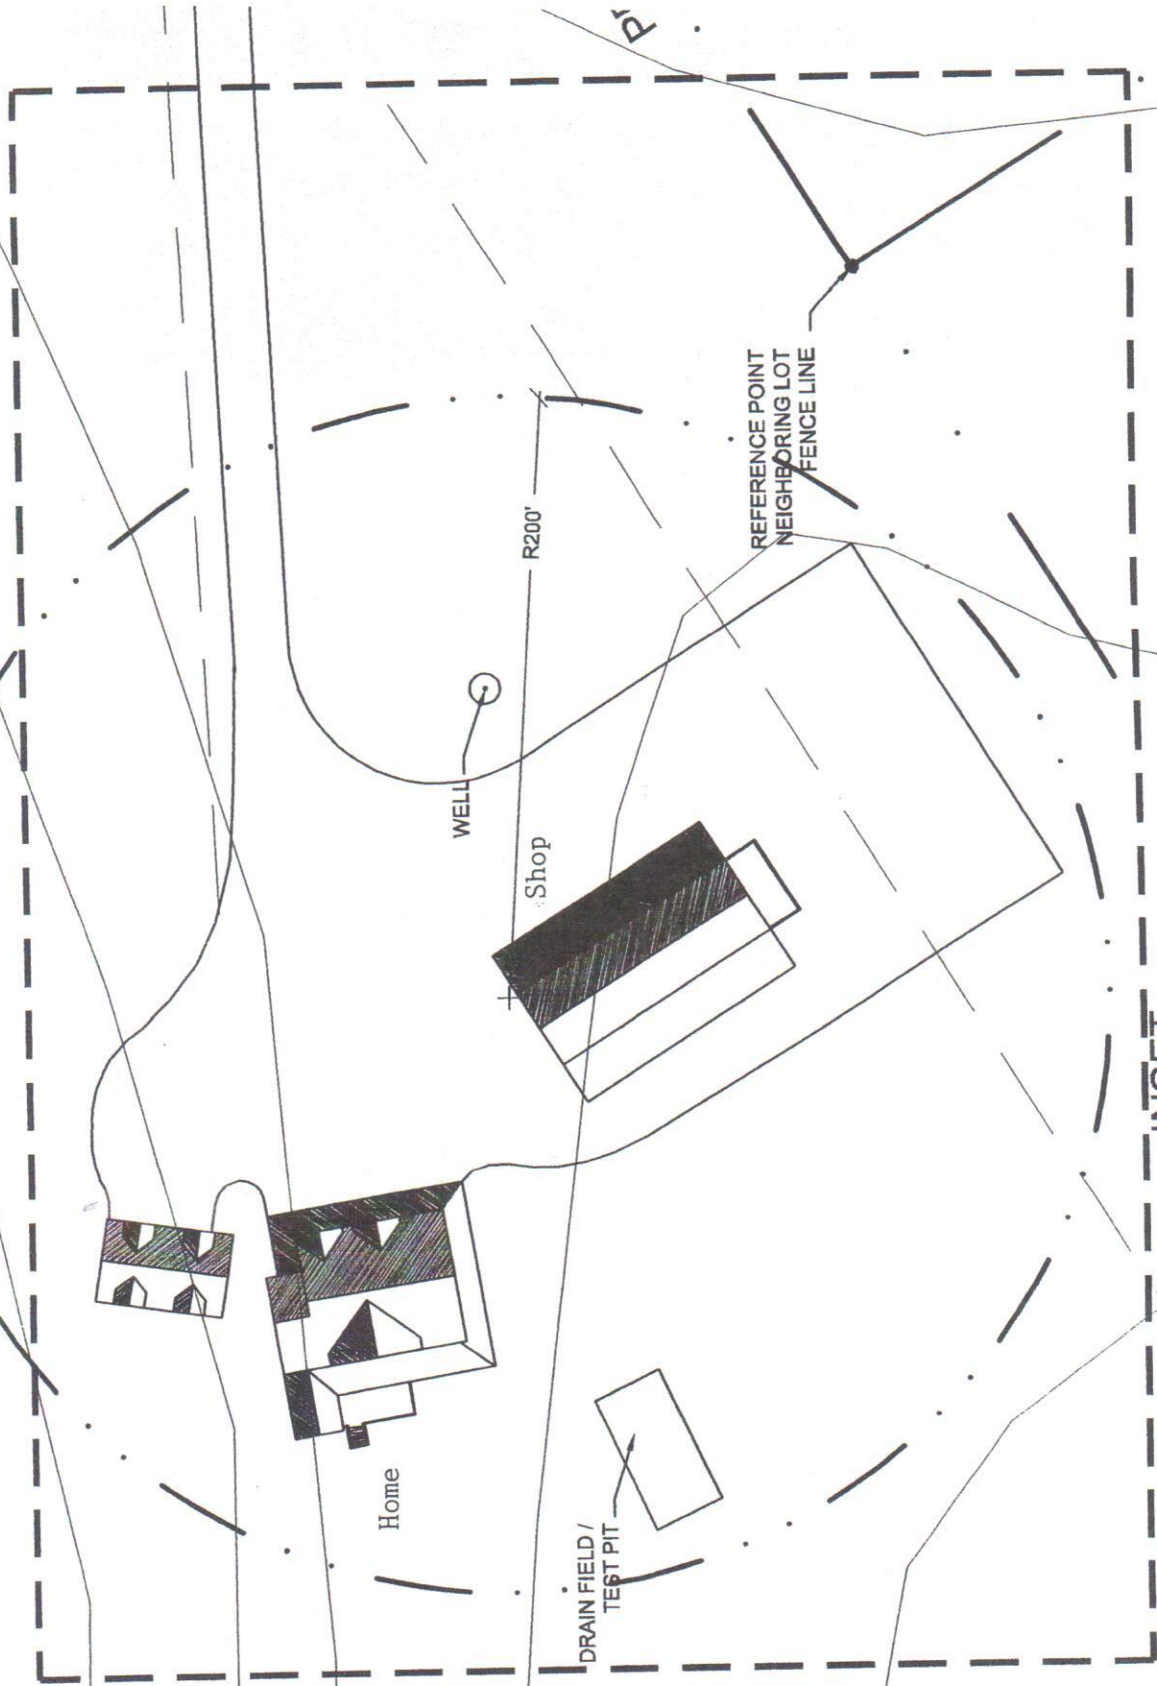

WELL

Shop

Home


DRAIN FIELD /
TEST PIT

R200'

REFERENCE POINT
NEIGHBORING LOT
FENCE LINE

INSET

ated in Part of Sections 28 and 33 of Township 3 North, Range 1 East, P.M.M., Broadwater County, Montana.

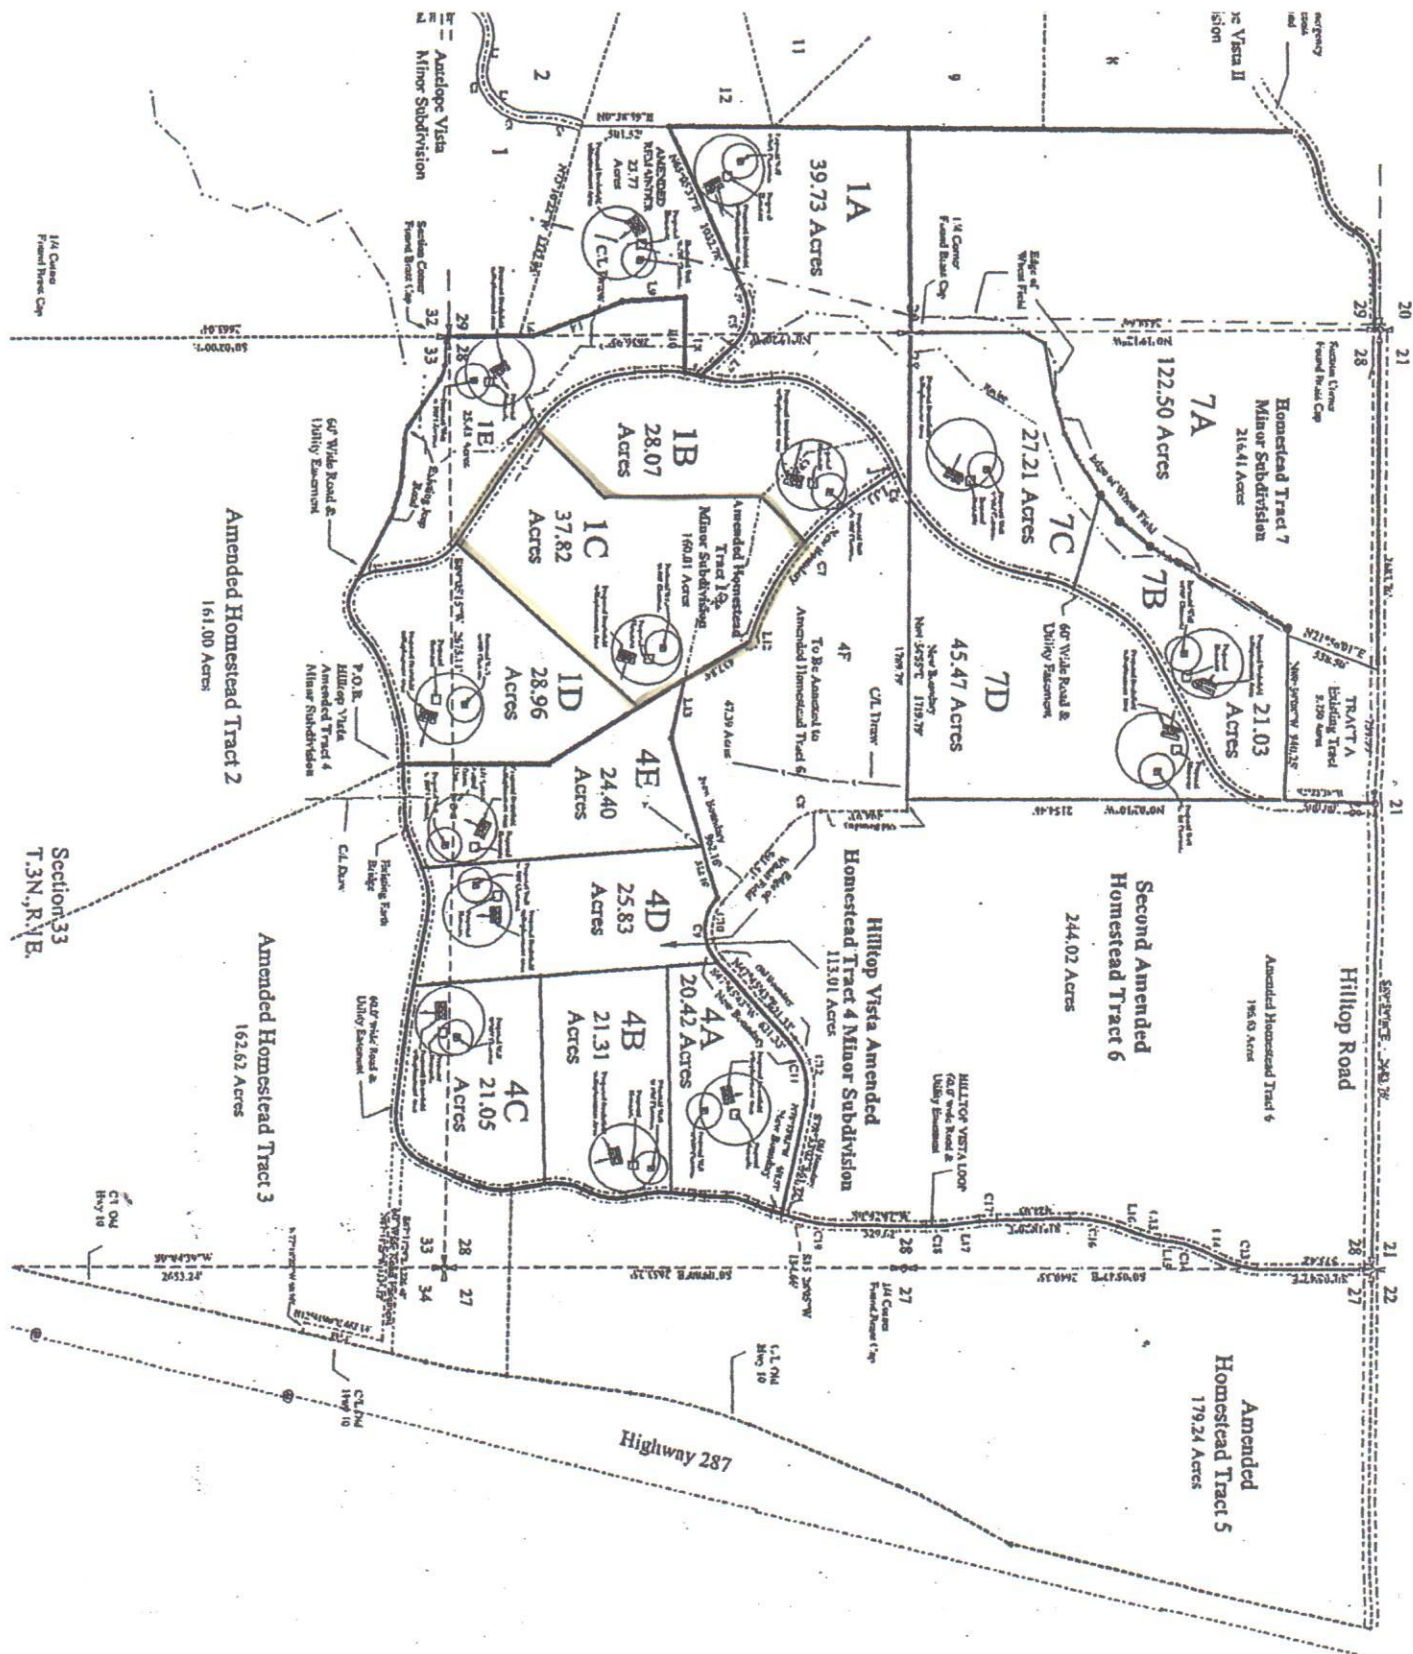


Permit # 05-108

Date of inspection 11/23/2005



NORTH

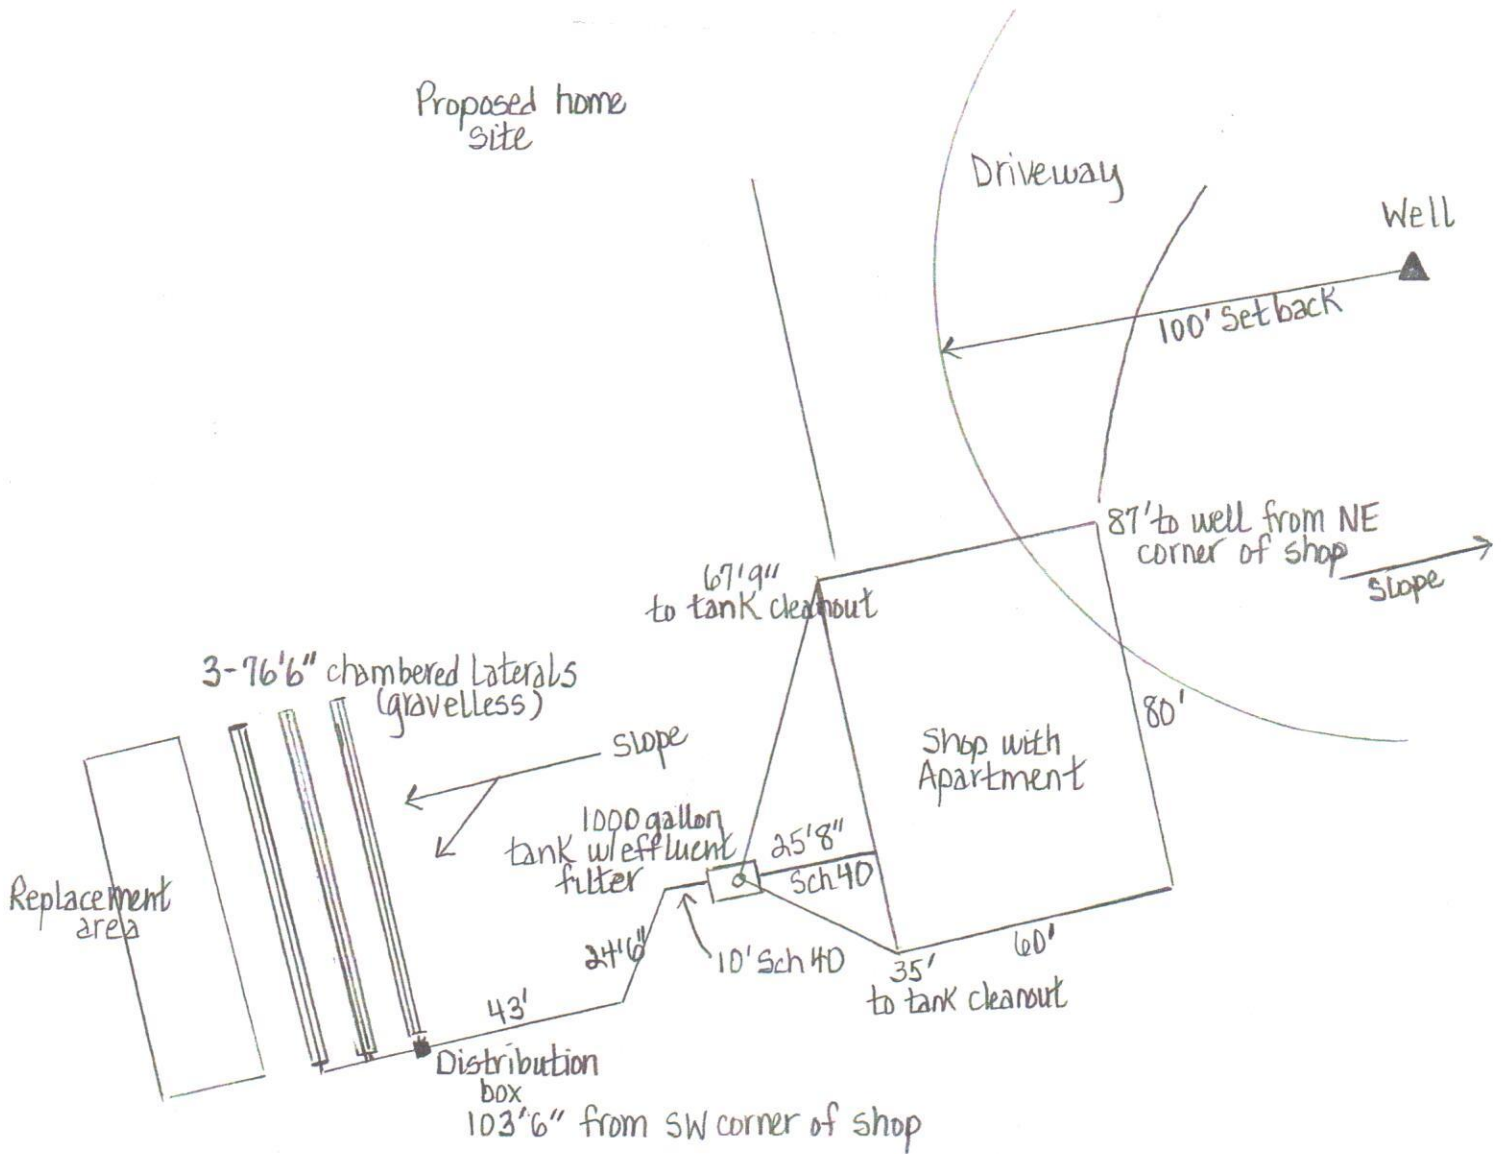

Scale: 1 inch = 40 feet

Signature Julie A. Lohert, R.S.